

UI Meter Diagrams

Netting/Buy-All

Residential (<25kW) Class I Generators

Overview

- UI Technical Review and acceptance required for all installations.
- Diagrams in this presentation are Metering diagrams not intended for use as Engineering or Construction diagrams.
- UI Guidebook of Requirements for Electric Service outlines the required metering configuration for new and existing services.
- “DG” in all drawings stands for Distributed Generation.
- UI will only meter at UI approved voltages.
- UI will install the production meter and revenue meter.
- UI strictly uses Advanced Meter Infrastructure (AMI) meters.
- Main Breaker will not be considered as a disconnect for PV. Dedicated AC disconnect(s) for generation must be used.
- Placard or lamicoid must be placed on the Utility Production meter socket with Tariff ID.
- All disconnects must be labeled (i.e., 1 of 2, 2 of 2, etc.)

10.3 Metering Equipment

Table of available metering equipment:

Service Type	Service Voltage	# Phases	# Wires	Service Amperes	# Meter Terminals	Hot/Cold Sequence
Self-Contained Metering (320 A continuous and below)						
Residential/Commercial	120/240	1	3	100/200/400	4	Hot *
Residential/Commercial	120/208	1	3	100 / 200	5	Hot
Commercial Network	120/208	1	3	100 / 200	5	Cold
Commercial	277/480	1	3	100 / 400	5	Cold
Commercial	120/208	3	4	200 / 400	7	Hot *
Commercial Network	120/208	3	4	200 / 400	7	Cold
Commercial	277/480	3	4	200 / 400	7	Cold
Transformer-Rated Metering						
Residential	120/240	1	3	Above 400	6	Cold
Commercial	120/208	1	3	Above 400	8	Cold
Commercial Network	277/480	3	4	Above 400	13	Cold
Commercial	120/208 277/480	3	4	Above 400	13	Cold
Fire Pump	120/208 277/480	3	4	Any	13	Cold


HOT SEQUENCE: METER-SWITCH-FUSE

COLD SEQUENCE: SWITCH-FUSE-METER

* CLASS 320 METERS USED IN MULTI-METER BANKS MUST BE COLD SEQUENCE

Netting Tariff

Production Meter in Series with Revenue Meter

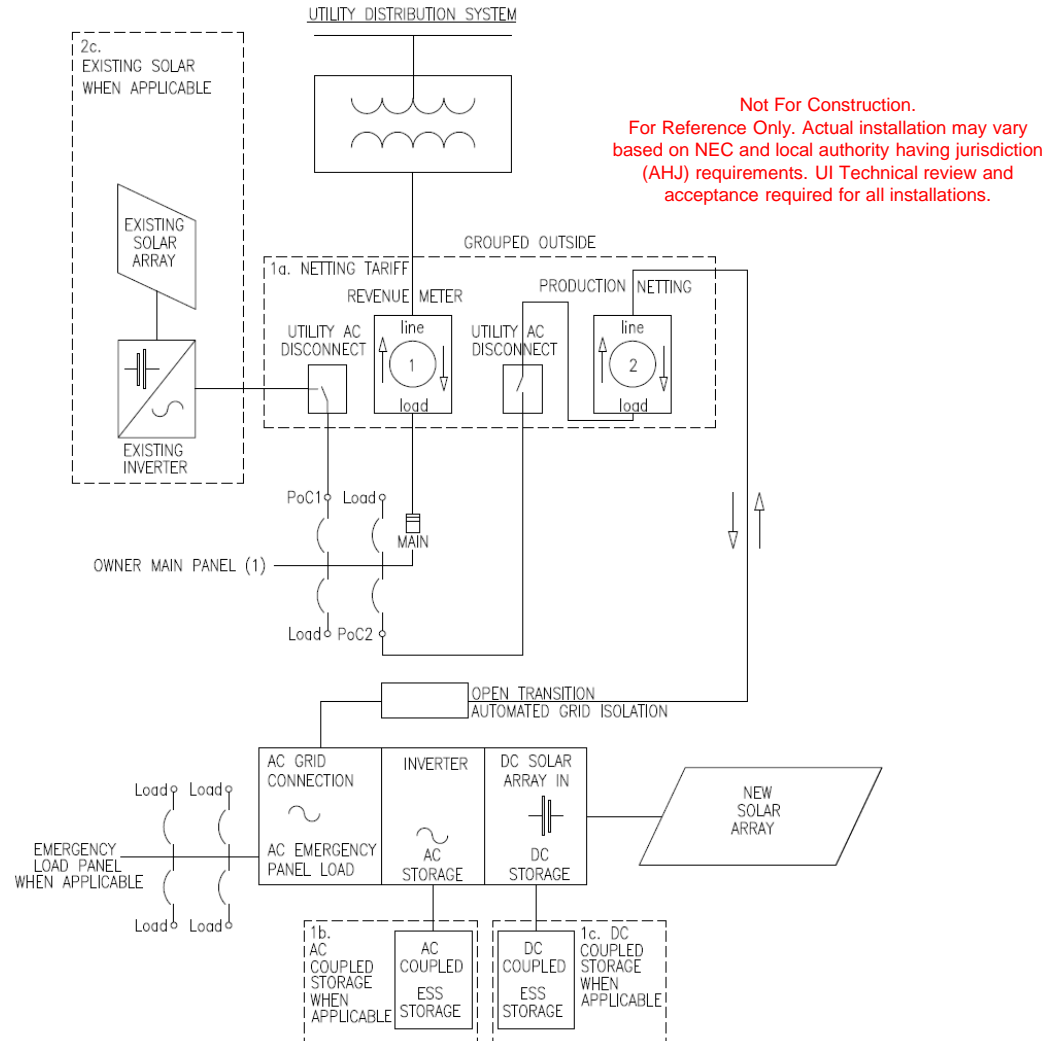

Note 1

- For Utility meter(s) located inside, the interconnecting customer will be required to upgrade and have the meter(s) relocated outside the customer's facility. All meters and switches are required to be grouped unless a written variance is granted by UI.

Note 2

- The utility AC disconnect must be located at ground level within 10 ft of the utility revenue meter(s), where utility personnel and first responders have 24/7 access. All fire, electric, building code and bylaws must be followed.

Note 3

- Production meter socket and/or CT compartment must follow the UI Guidebook of Requirements.
- Revenue/Billing meter socket and/or CT compartment cannot be used as a tie point for DG equipment.

Note 4

- Socket must have a lever bypass. Line and load conductors for the production meter cannot be in the same raceway (i.e., trough). When neutral isolation is required, a neutral isolation kit from the same manufacturer of the socket must be used. Splices are not permitted.


Note 5

- The utility is not responsible for customer damages incurred during islanding or solar backup. Customer may need to contract additional insurance policy.
- To utilize ESS and solar array as a backup during grid outage, a dedicated circuit, independent from the production and billing meters, must be used. The production and billing meter cannot be energized during islanding or solar backup.
- Automated Grid Isolation is required for islanding or solar backup applications.
- Netting tariff prohibits the use of ESS to re-sell grid energy back to the grid.

Note 6

- Islanding accomplished by multiple isolation devices must be open transition and synchronized, consult with UI Engineering prior to installation. The production and billing meter cannot be energized during islanding.
- Existing transfer switches for Emergency Backup systems can NOT be used as one of the isolation devices required for islanding and/or incorporation of ESS under the Netting tariff configuration.

Buy-All Single Family Production Meter in Parallel with Revenue Meter

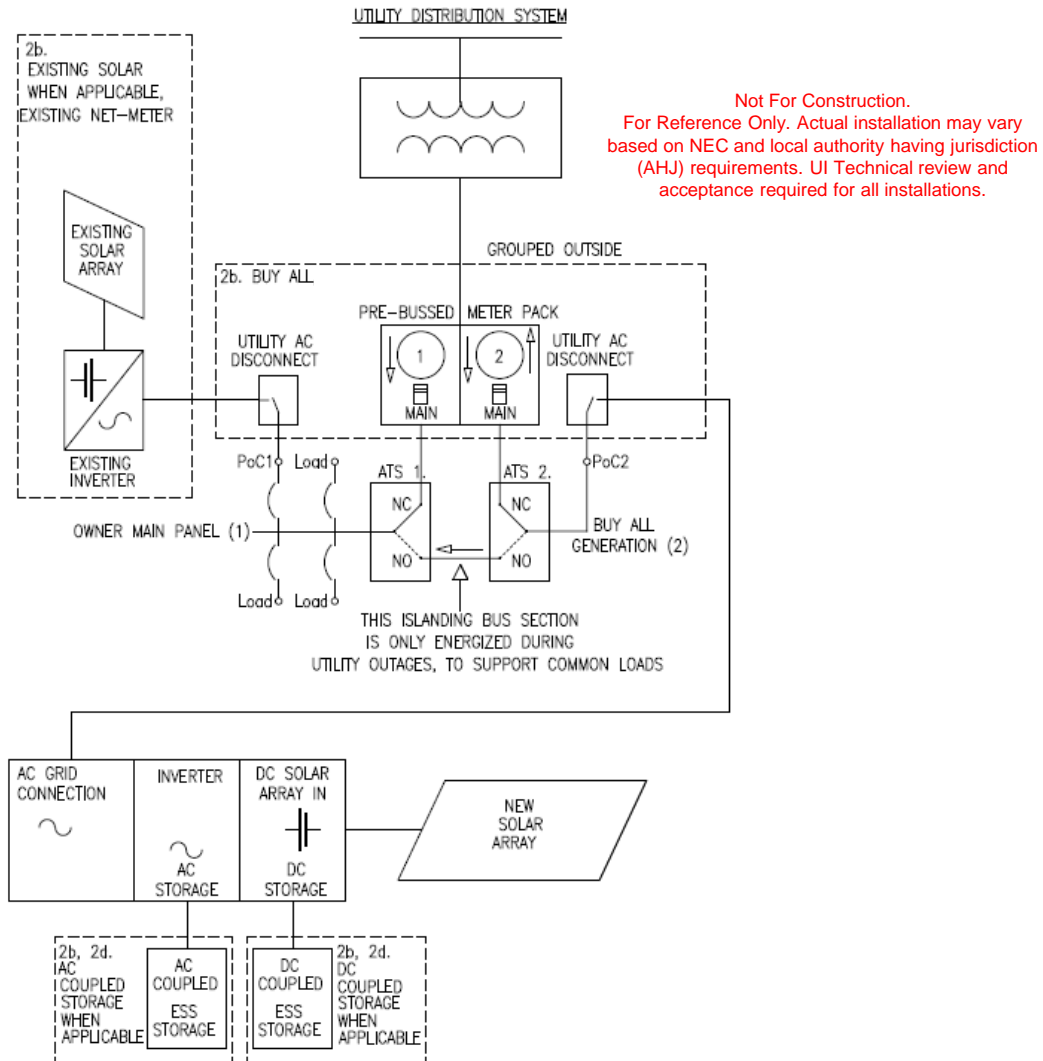

Note 1

- Service entrance conductors must be sized for the absolute sum of both load and generation. Service increase may be required to accommodate for the addition of the net production meter(s).

Note 2

- For overhead services: A lever bypass pre-bussed meter pack must be used unless a written variance is granted by Engineering. POI of interconnection must be made at the weather head.
- For underground service: A lever bypass pre-bussed meter pack must be used. Consult with Engineering for the physical installation.

Note 3

- For Utility meter(s) located inside, the interconnecting customer will be required to upgrade and have the meter(s) relocated outside the customer's facility. All meters and switches are required to be grouped unless a written variance is granted.

Note 4

- The utility AC disconnect must be located at ground level within the vicinity of the utility revenue meter(s), where utility personnel and first responders have 24/7 access. All fire, electric, building code and bylaws must be followed.

Note 5

- The utility is not responsible for customer damages incurred during islanding or solar backup. Customer may need to contract additional insurance policy.
- To utilize ESS and solar array as a backup during grid outage, a dedicated circuit, independent from the production and billing meters, must be used.

Note 6


- Islanding must be facilitated by synchronized open transition transfer switches, consult with UI Engineering prior to installation. The production and billing meter cannot be energized during islanding.
- Existing transfer switches for Emergency Backup systems can NOT be used as one of the transfer switch devices required for the Buy-All tariff configuration.

Note 7

- Additional solar must be added behind the new production meter.

Buy-All Multi-Family

Production Meter in Parallel with Revenue Meter

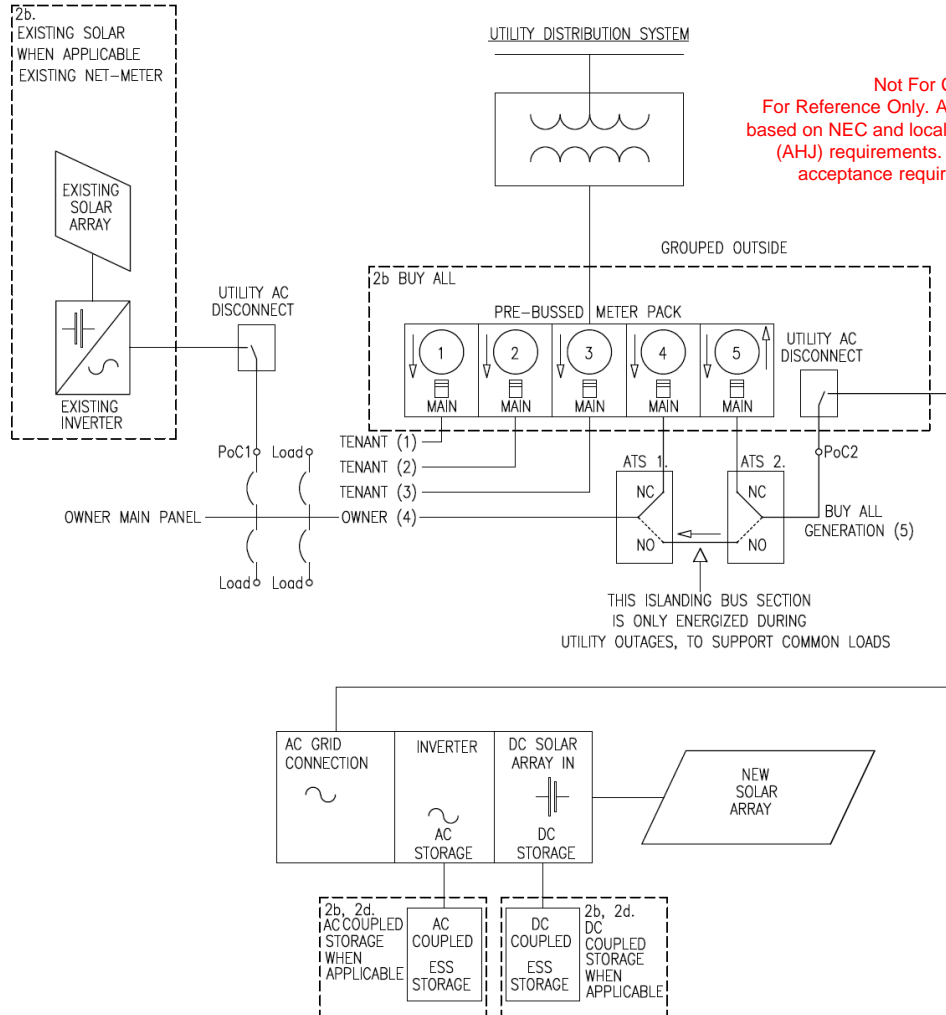

Not For Construction.
For Reference Only. Actual installation may vary
based on NEC and local authority having jurisdiction
(AHJ) requirements. UI Technical review and
acceptance required for all installations.

Note 1

- Service entrance conductors must be sized for the absolute sum of both load and generation. Service increase may be required to accommodate for the addition of the net production meter(s).

Note 2

- For overhead services: A lever bypass pre-bussed meter pack must be used unless a written variance is granted by Engineering. POI of interconnection must be made at the weather head.
- For underground service: A lever bypass pre-bussed meter pack must be used. Consult with Engineering for the physical installation.

Note 3

- For Utility meter(s) located inside, the interconnecting customer will be required to upgrade and have the meter(s) relocated outside the customer's facility. All meters and switches are required to be grouped unless a written variance is granted.

Note 4

- The utility AC disconnect must be located at ground level within the vicinity of the utility revenue meter(s), where utility personnel and first responders have 24/7 access. All fire, electric, building code and bylaws must be followed.

Note 5

- The utility is not responsible for customer damages incurred during islanding or solar backup. Customer may need to contract additional insurance policy.
- To utilize ESS and solar array as a backup during grid outage, a dedicated circuit, independent from the production and billing meters, must be used.

Note 6

- Islanding must be facilitated by synchronized open transition transfer switches, consult with UI Engineering prior to installation. The production and billing meter cannot be energized during islanding.
- Existing transfer switches for Emergency Backup systems can NOT be used as one of the transfer switch devices required for the Buy-All tariff configuration.

Note 7

- Additional solar must be added behind the new production meter.